


# NOTES:

1. PLACE STOP BOX WITHIN 5 FT EITHER SIDE OF PL PLACEMENT OUTSIDE PL IS PREFERRED.
2. INDOOR METER SETTING IS PERMITTED ONLY IF TOTAL LENGTH OF SERVICE PIPE DOES NOT EXCEED 60 FT FROM MAIN TO METER SETTING.
3. INDOOR METER SHALL BE PLACED IN BASEMENT WITH FLOOR DRAIN NEARBY.
4. ITRON REMOTE ERT WILL BE MOUNTED BY DENVER WATER AT TIME METER IS SET. ERT IS USUALLY LOCATED NEAR BASEMENT CEILING ON OUTSIDE WALL FACING STREET. IF CONDITIONS INTERFERE WITH RADIO METER READING, ERT MAY BE MOUNTED ON OUTSIDE OF BUILDING FACING STREET.
5. NO BENDS, FITTINGS, CONNECTIONS, OR CHANGES IN PIPE SIZE PERMITTED ON TAP AND METER OUTLET VALVE, EXCEPT AS SHOWN.
6. PROPERTY OWNER OWNS ENTIRE SERVICE LINE FROM CORP STOP AT STREET MAIN. OWNER IS RESPONSIBLE FOR REPAIRING LEAKS BEGINNING AT THE CURB STOP. OWNER IS RESPONSIBLE FOR ALL OTHER REPAIRS OR SERVICE LINE REPLACEMENT BEGINNING AT THE MAIN. DENVER WATER WILL REPAIR SERVICE LINE LEAKS BETWEEN THE WATER MAIN AND THE OUTLET SIDE OF THE CURB STOP.
7. DENVER WATER IS NOT RESPONSIBLE FOR ANY DAMAGE THAT MAY OCCUR DUE TO A LEAK ANYWHERE ON THE SERVICE LINE. ALL DAMAGE IS THE RESPONSIBILITY OF THE OWNER OF THE PROPERTY.

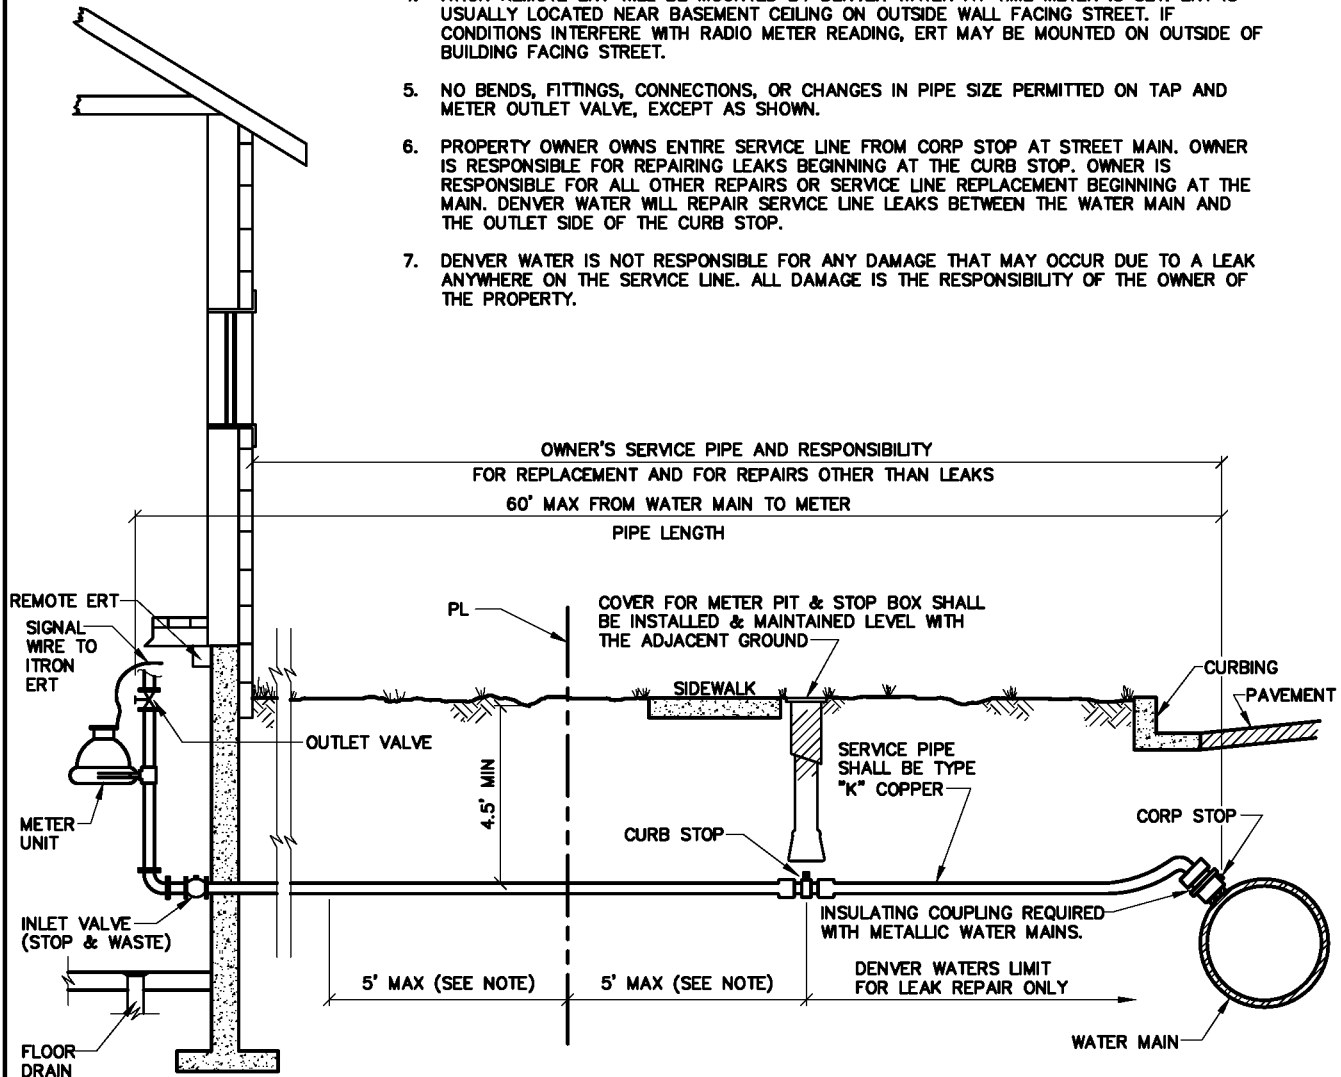

ANY VARIATION FROM THIS STANDARD REQUIRES APPROVAL PRIOR TO INSTALLATION FROM CUSTOMER SERVICE FIELD SECTION.

## DENVER WATER

1600 West 12th Avenue • Denver, Colorado 80204  
Phone (303) 628-6000 • Telecopier No. (303) 628-6851

## SERVICE LINE, STOP BOX AND INSIDE METER INSTALLATION FOR 3/4" AND 1" METER

Scale: NONE Date: AUGUST 1995  
Drawn: C.B.B. Tr:      Ck:       
Approved: [Signature] Dr. 127 No. 35